



CSI
Certificazione e Testing

RAPPORTO DI PROVA
(Test Report)

Pag. **9**
di/of
pag. **24**


N° **0058/DEU/CPD/06**

Data: **27/06/2006**
Date:

Tested element: **SGG Stadip 55.1**

Sample surface area S = 1,9 m²
Volume of receiving room V = 86 m³
Volume of source room V = 98 m³

FREQ. Hz	R dB
100	29,4
125	31,0
160	29,9
200	26,4
250	29,3
315	29,3
400	30,8
500	34,2
630	35,1
800	36,0
1000	34,6
1250	32,7
1600	32,3
2000	37,0
2500	40,8
3150	44,2
4000	47,8
5000	49,5

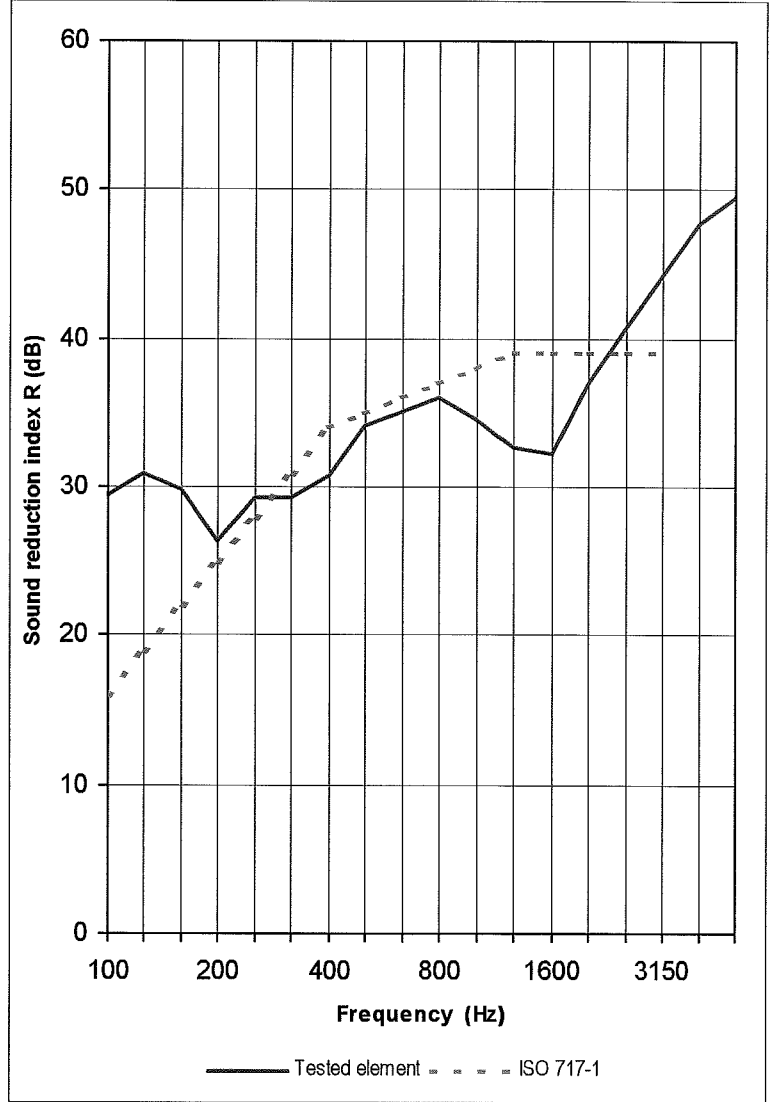

Rating according to ISO 717-1 (in the band 100 ÷ 3150 Hz) based on laboratory measurements:

R_w (C; C_{tr}) = 35 (-1 ; -2) dB