



CSI
Certificazione e Testing

RAPPORTO DI PROVA
(Test Report)

Pag. **23**
di/of
pag. **24**


N° **0058/DEU/CPD/06**

Data: **27/06/2006**
Date:

Tested element: **SGG Stadip Silence 66.1**

Sample surface area S = 1,9 m²
Volume of receiving room V = 86 m³
Volume of source room 98 m³

FREQ. Hz	R dB
100	31,6
125	31,7
160	32,5
200	30,2
250	31,8
315	32,3
400	33,3
500	36,2
630	37,5
800	38,6
1000	39,6
1250	39,9
1600	40,0
2000	40,5
2500	43,8
3150	47,0
4000	51,2
5000	53,3

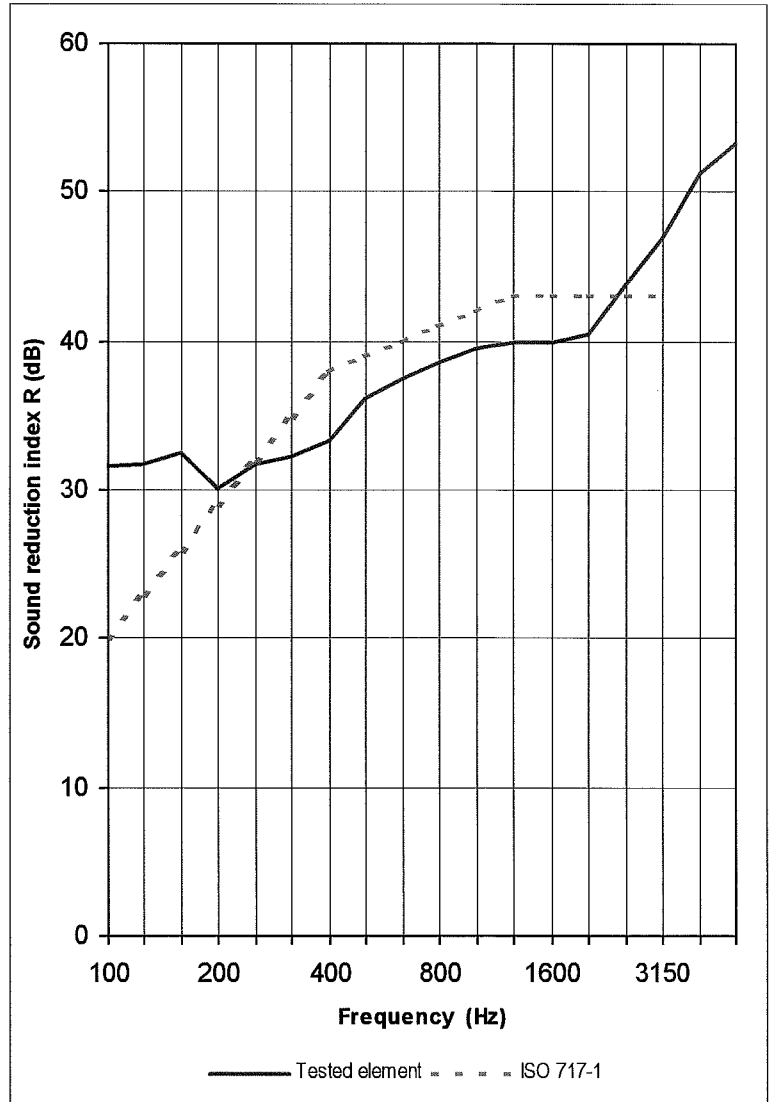

Rating according to ISO 717-1 (in the band 100 ÷ 3150 Hz) based on laboratory measurements:

$R_W(C;C_{tr}) = 39 (0; -2) \text{ dB}$