



CSI
Certificazione e Testing

RAPPORTO DI PROVA
(Test Report)

Pag. 19

di/of

pag. 24

N° 0058/DEU/CPD/06


Data: 27/06/2006

Date:

Tested element: **SGG Stadip Silence 55.1**

Sample surface area S = 1,9 m²
Volume of receiving room V = 86 m³
Volume of source room 98 m³

FREQ. Hz	R dB
100	29,1
125	29,1
160	31,7
200	28,5
250	30,7
315	31,6
400	32,6
500	35,3
630	36,0
800	37,8
1000	38,9
1250	40,0
1600	40,4
2000	39,5
2500	40,6
3150	43,9
4000	48,9
5000	50,9

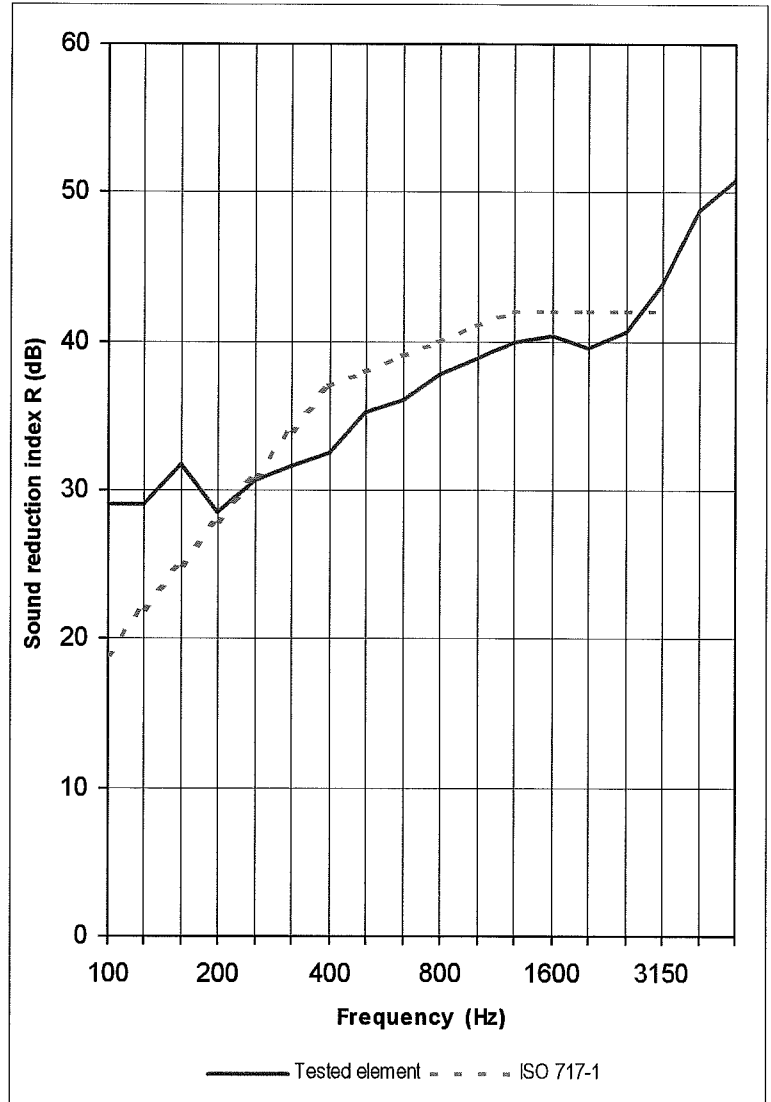

Rating according to ISO 717-1 (in the band 100 ÷ 3150 Hz) based on laboratory measurements:

R_w (C; C_{tr}) = 38 (0 ; -2) dB