



**CSI**  
Certificazione e Testing

**RAPPORTO DI PROVA**  
(Test Report)

N° **0225/DEU/CPD/06**


Pag. 7  
di/of  
pag. 31

Data: **27/10/2006**  
Date:

Tested element: **SGG PLANILUX 6 (12) SGG PLANILUX 10**

Sample surface area            S =            1,9 m<sup>2</sup>  
Volume of receiving room       V =            86 m<sup>3</sup>  
Volume of source room         98 m<sup>3</sup>

FREQ. Hz	R dB
100	26,8
125	30,1
160	26,5
200	23,1
250	28,0
315	29,9
400	32,0
500	33,8
630	37,6
800	40,5
1000	40,6
1250	39,1
1600	39,3
2000	38,8
2500	39,2
3150	42,5
4000	47,6
5000	49,2

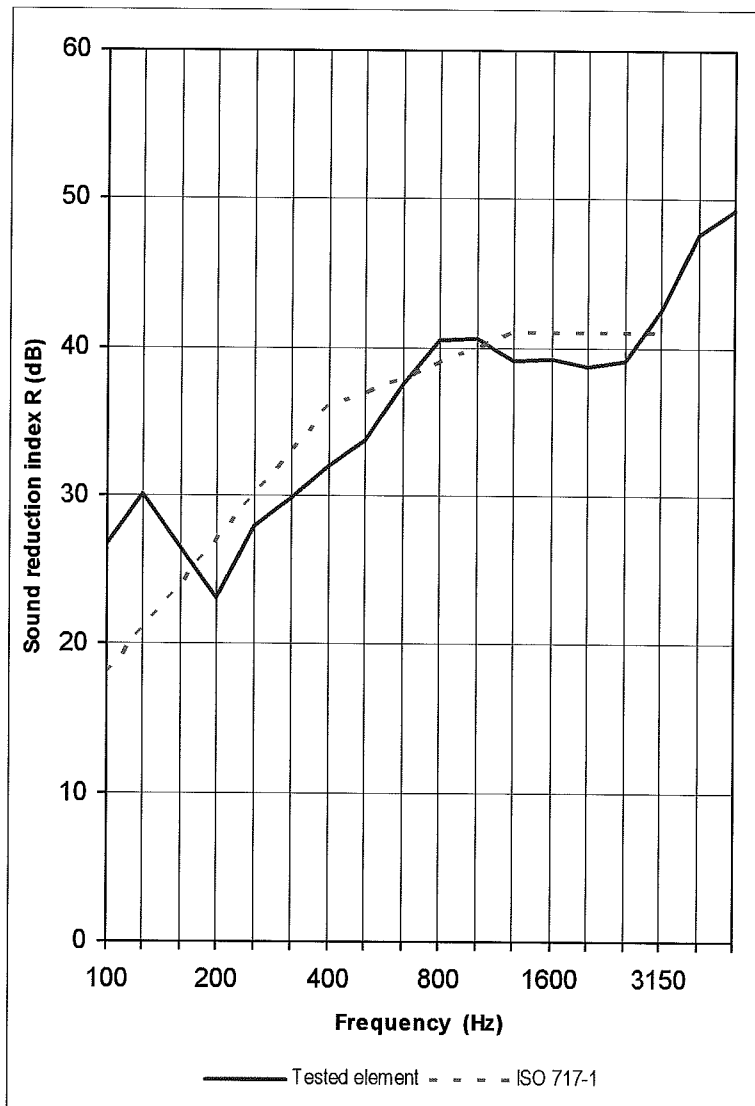

Rating according to ISO 717-1 (in the band 100 ÷ 3150 Hz) based on laboratory measurements:

**$R_w (C; C_{tr}) = 37 (-1 ; -3) \text{ dB}$**