



**CSI**  
Certificazione e Testing

**RAPPORTO DI PROVA**  
(Test Report)

N° **0225/DEU/CPD/06**


Pag. **13**  
di/of  
pag. **31**

Data: **27/10/2006**  
Date:

Tested element: **SGG PLANILUX 4 (6) SGG PLANILUX 10**

Sample surface area            S =        1,9 m<sup>2</sup>  
Volume of receiving room       V =        86 m<sup>3</sup>  
Volume of source room                        98 m<sup>3</sup>

FREQ. Hz	R dB
100	29,3
125	31,3
160	29,9
200	27,5
250	26,5
315	25,6
400	26,3
500	30,3
630	34,5
800	36,9
1000	37,1
1250	37,5
1600	39,8
2000	43,6
2500	44,9
3150	43,5
4000	46,4
5000	48,4

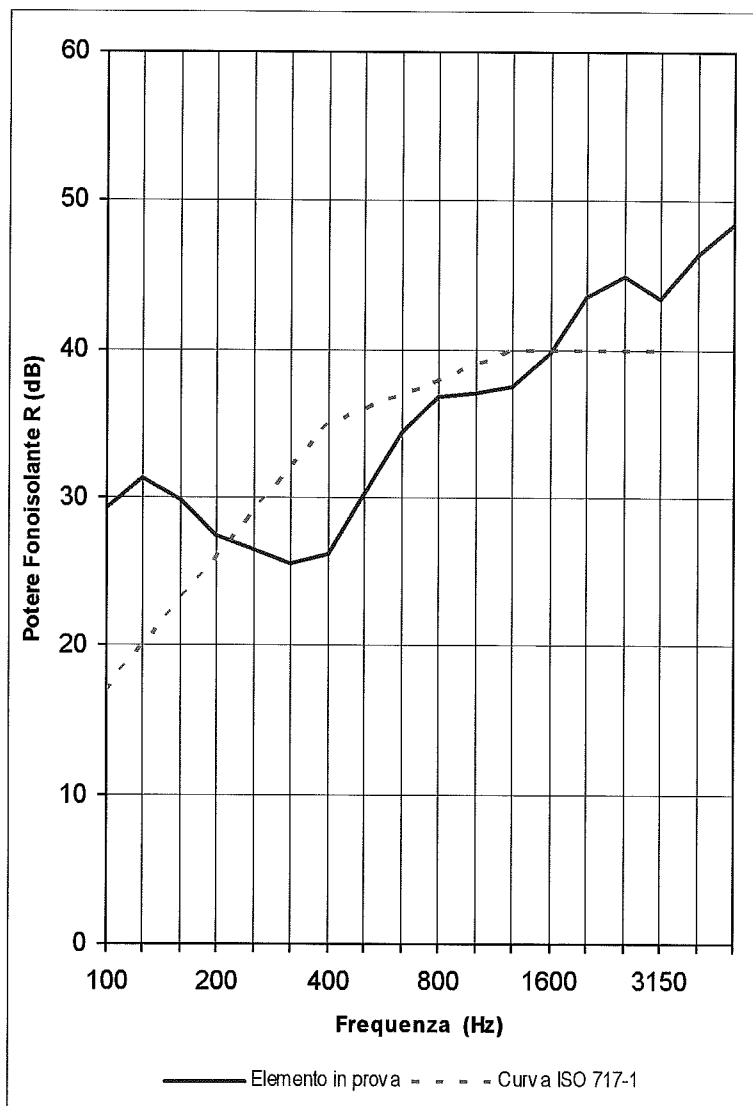

Rating according to ISO 717-1 (in the band 100 ÷ 3150 Hz) based on laboratory measurements:

**$R_w (C; C_{tr}) = 36 (-1 ; -3) \text{ dB}$**