



CSI
Certificazione e Testing

RAPPORTO DI PROVA
(Test Report)

N° **0225/DEU/CPD/06**


Pag. **16**
di/of
pag. **31**

Data: **27/10/2006**
Date:

Tested element: **SGG STADIP SILENCE 44-2 (20) SGG STADIP SILENCE 66-2**

Sample surface area S = 1,9 m²
Volume of receiving room V = 86 m³
Volume of source room 98 m³

FREQ. Hz	R dB
100	27,9
125	32,6
160	33,1
200	35,3
250	39,8
315	40,2
400	42,1
500	45,5
630	49,1
800	51,7
1000	53,3
1250	53,9
1600	53,7
2000	54,3
2500	55,1
3150	56,1
4000	59,8
5000	62,3

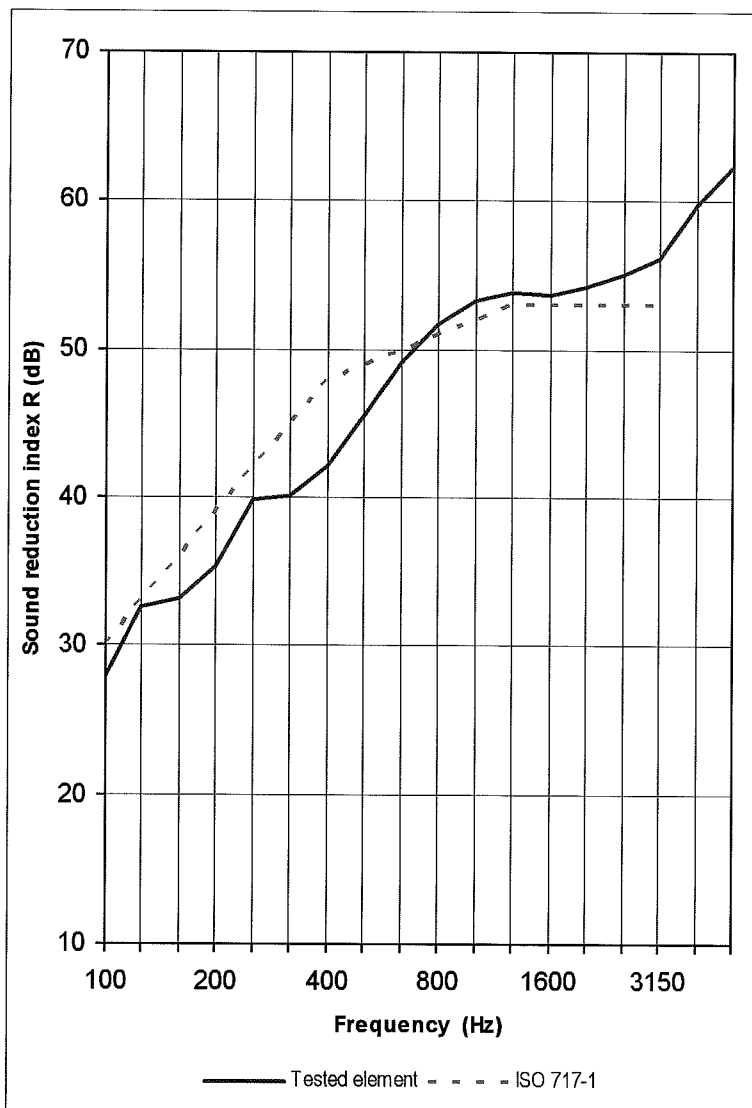

Rating according to ISO 717-1 (in the band 100 ÷ 3150 Hz) based on laboratory measurements:

R_w (C; C_{tr}) = 49 (-2 ; -6) dB