



CSI
Certificazione e Testing

RAPPORTO DI PROVA
(Test Report)

N° **0225/DEU/CPD/06**


Pag. **19**
di/of
pag. **31**

Data: **27/10/2006**
Date:

Tested element: **SGG STADIP SILENCE 33-2 (20) SGG STADIP SILENCE 44-2**

Sample surface area S = 1,9 m²
Volume of receiving room V = 86 m³
Volume of source room 98 m³

FREQ. Hz	R dB
100	23,9
125	27,8
160	27,2
200	27,5
250	33,3
315	33,3
400	36,2
500	40,3
630	44,1
800	48,6
1000	52,5
1250	54,7
1600	55,6
2000	56,2
2500	55,4
3150	55,5
4000	58,1
5000	61,5

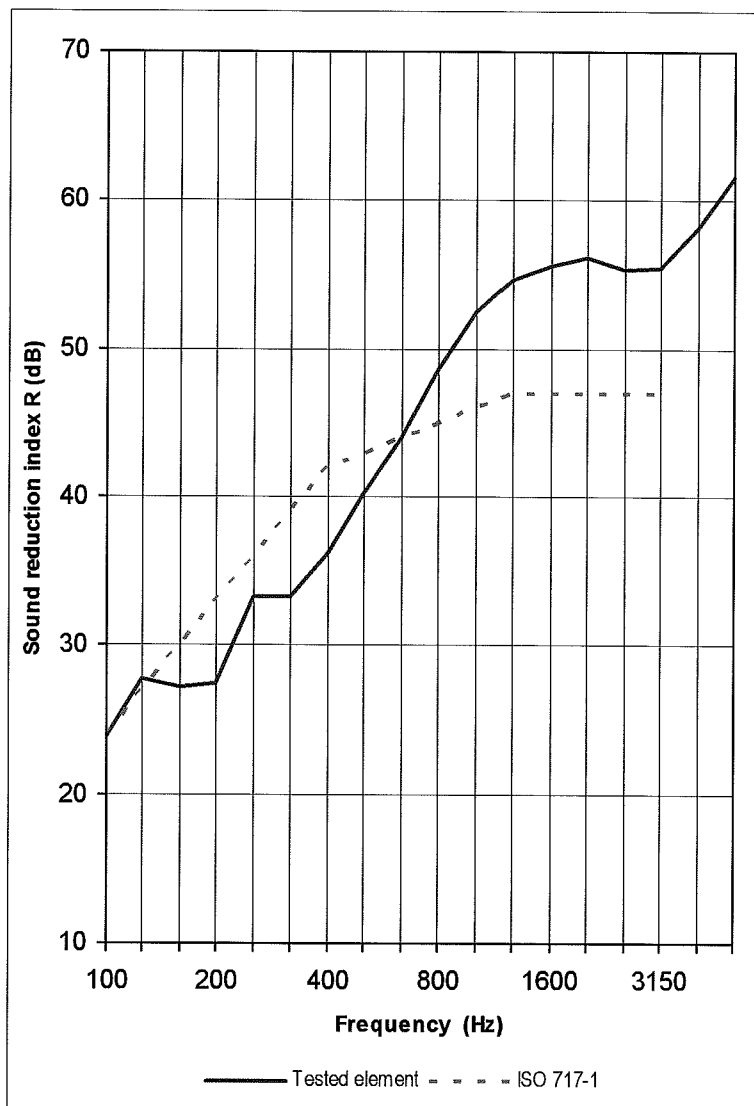

Rating according to ISO 717-1 (in the band 100 ÷ 3150 Hz) based on laboratory measurements:

$R_w (C; C_{tr}) = 43 (-1 ; -6) \text{ dB}$