


TEST RESULTS

Tested element: SGG Stadip Silence 22.1

Specimen surface $S = 1,89\text{m}^2$
Receiving room volume $V = 86\text{m}^3$
Source room volume 98m^3

FREQ. Hz	R dB
100	21,1
125	20,2
160	20,1
200	22,9
250	23,4
315	25,0
400	27,0
500	28,6
630	30,7
800	32,3
1000	34,2
1250	35,4
1600	36,7
2000	37,5
2500	38,2
3150	38,9
4000	38,0
5000	37,0


$R_w (C; C_{tr}) = 33 (-1 ; -4) \text{ dB}$

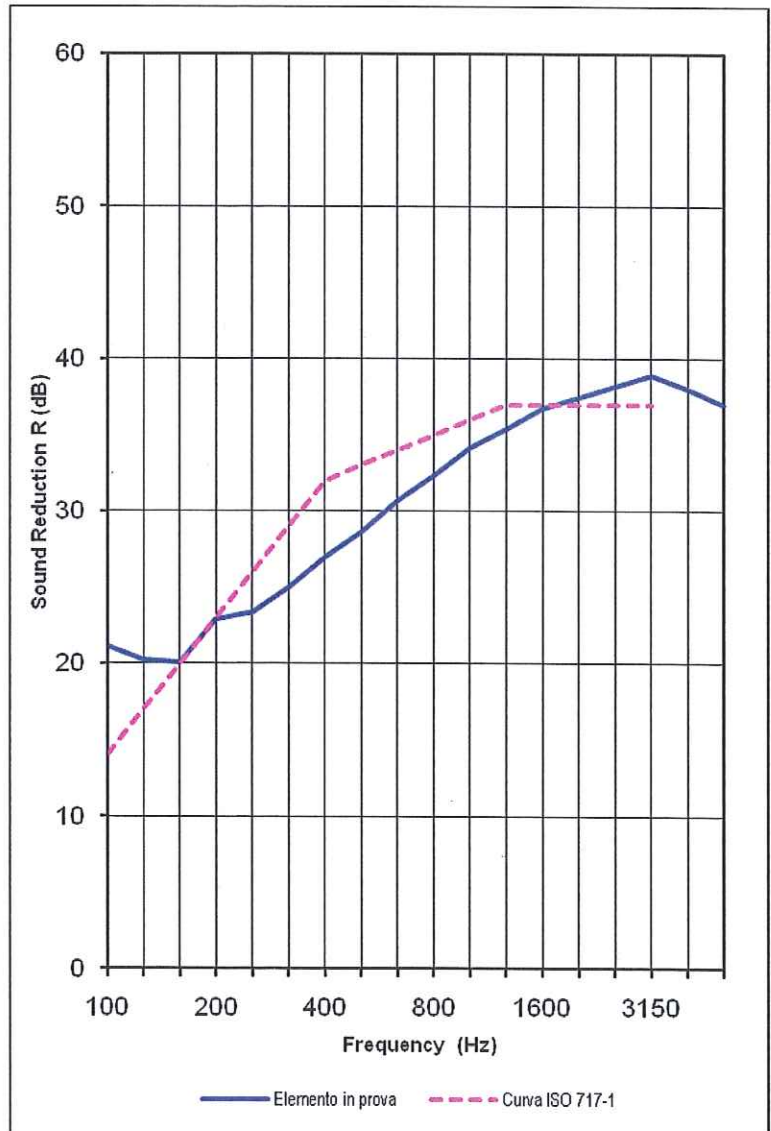

Rating according to ISO 717-1 (in the band 100 ÷ 3150 Hz) based on laboratory measurements:

IL RESP. Divisione Costruzioni
Division Head

Paolo Mele



IL RESP. DEL CENTRO
Managing Director

Pasqualino Cau

